



- NOTES:
1. DRIPSHIELD IS OPTIONAL
 2. 19IN AND 23IN RACKMOUNT BRACKETS ARE OPTIONAL
 3. THE INSTALLATION OF THIS EQUIPMENT SHALL COMPLY WITH ALL LOCAL AUTHORITY AND APPLICABLE BUILDING CODES
 4. PROVIDE A MINIMUM CLEARANCE (FROM CHARGER CHASSIS) OF 6.0IN ON TOP, 4.0IN ON BOTTOM, AND 0.5IN ON SIDES OF UNIT FOR VENTILATION

| REVISIONS | | | | |
|-----------|-----|-------------------------------------|-----------|----------|
| DCN | REV | DESCRIPTION | DATE | APPROVED |
| 107342 | A | INITIAL RELEASE | 9/8/2017 | ERS |
| 109275 | B | SHIELD DIMENSION CORRECTED TO 15.46 | 12/9/2025 | L.P. |



THESE VIEWS SHOWN WITH OPTIONAL DRIP SHIELD

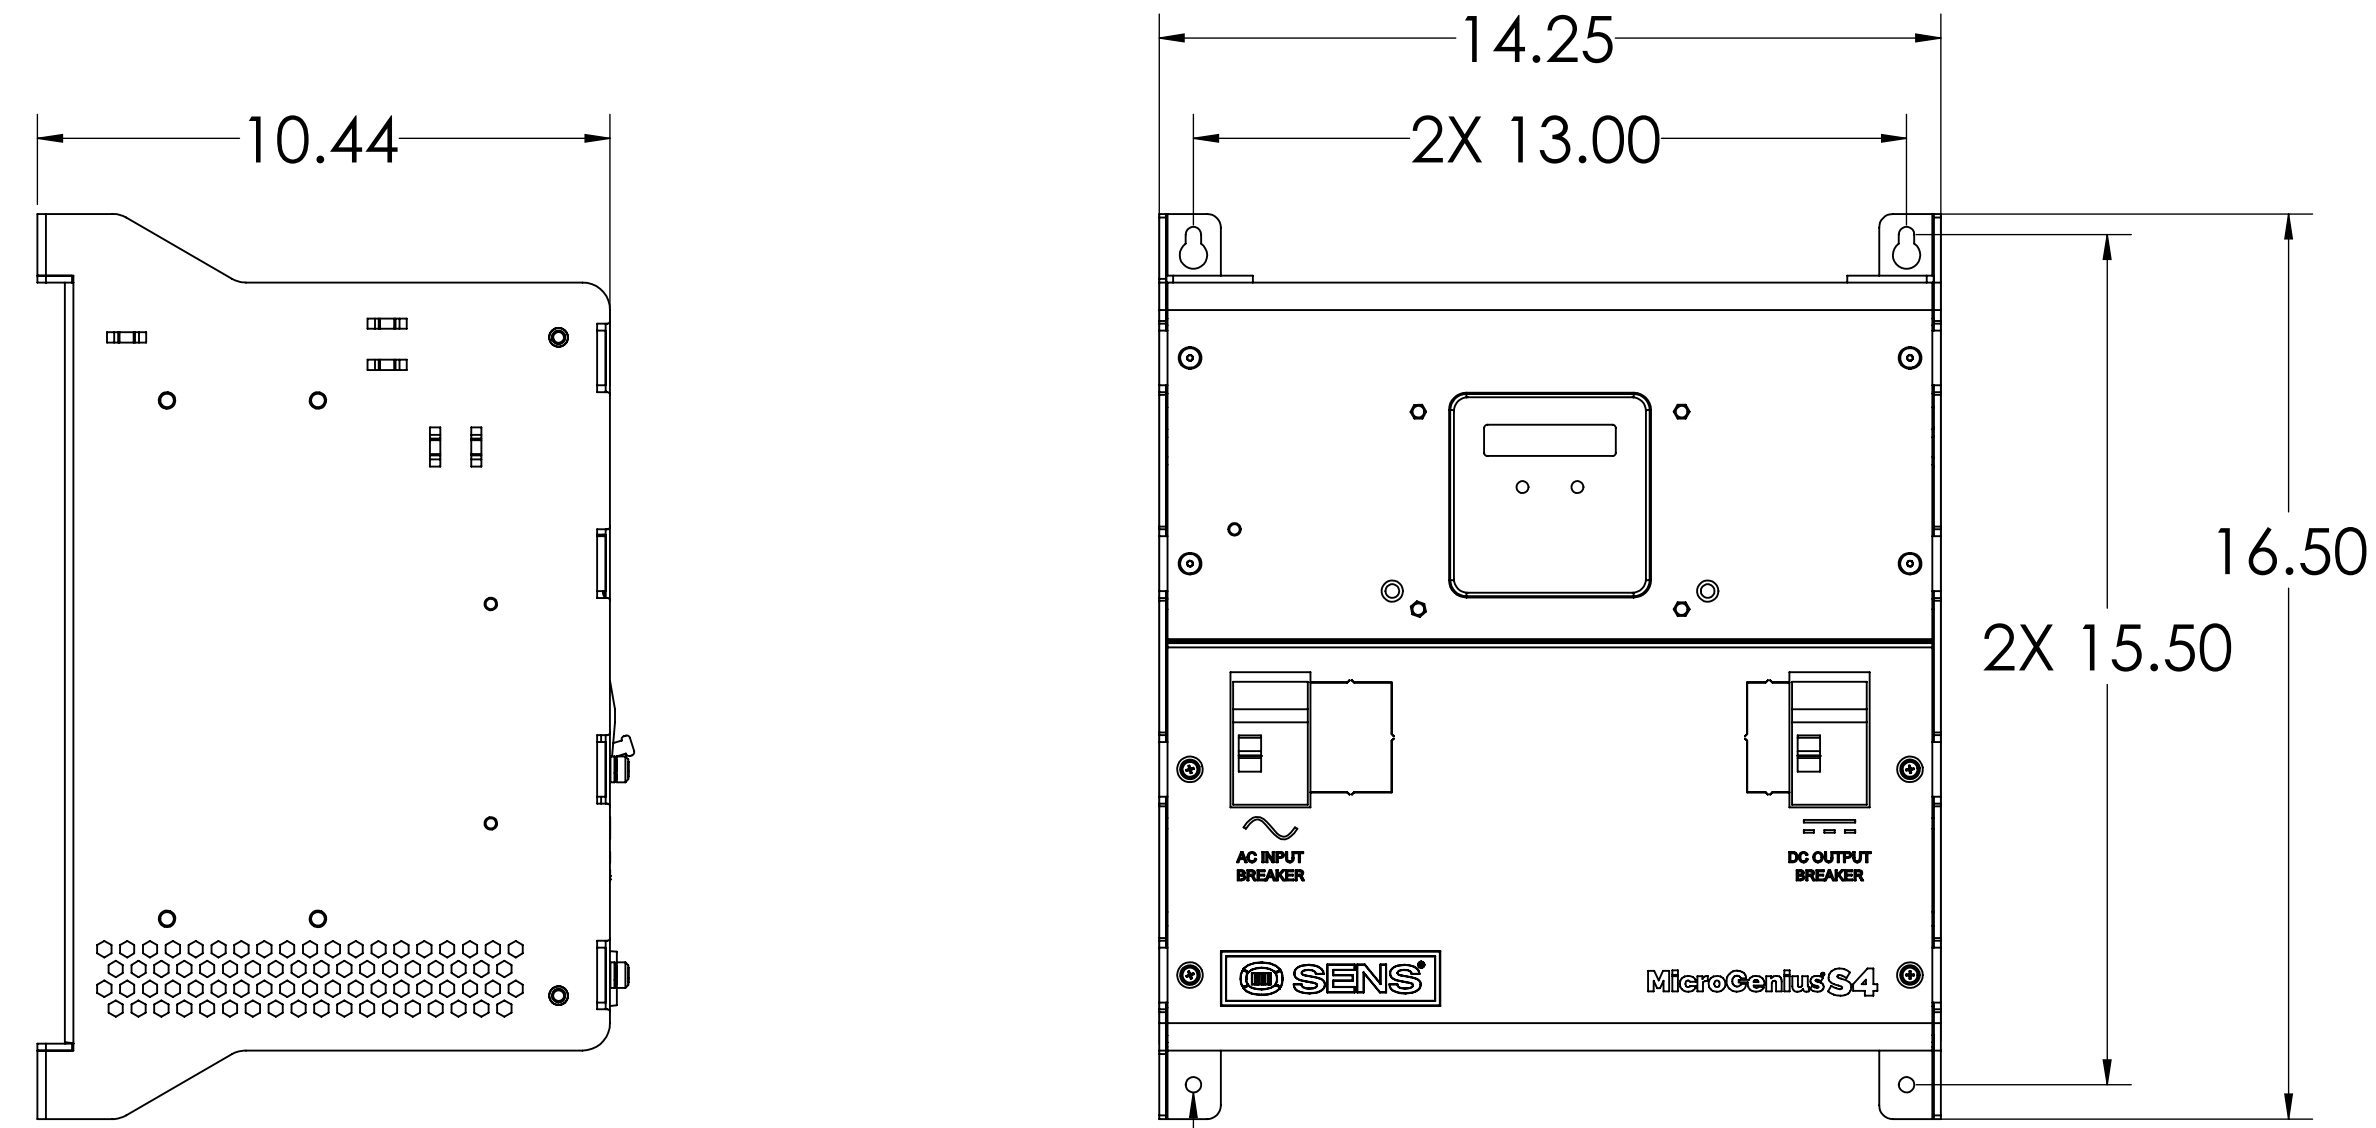


4X MOUNTING LOCATIONS FOR 1/4IN HARDWARE

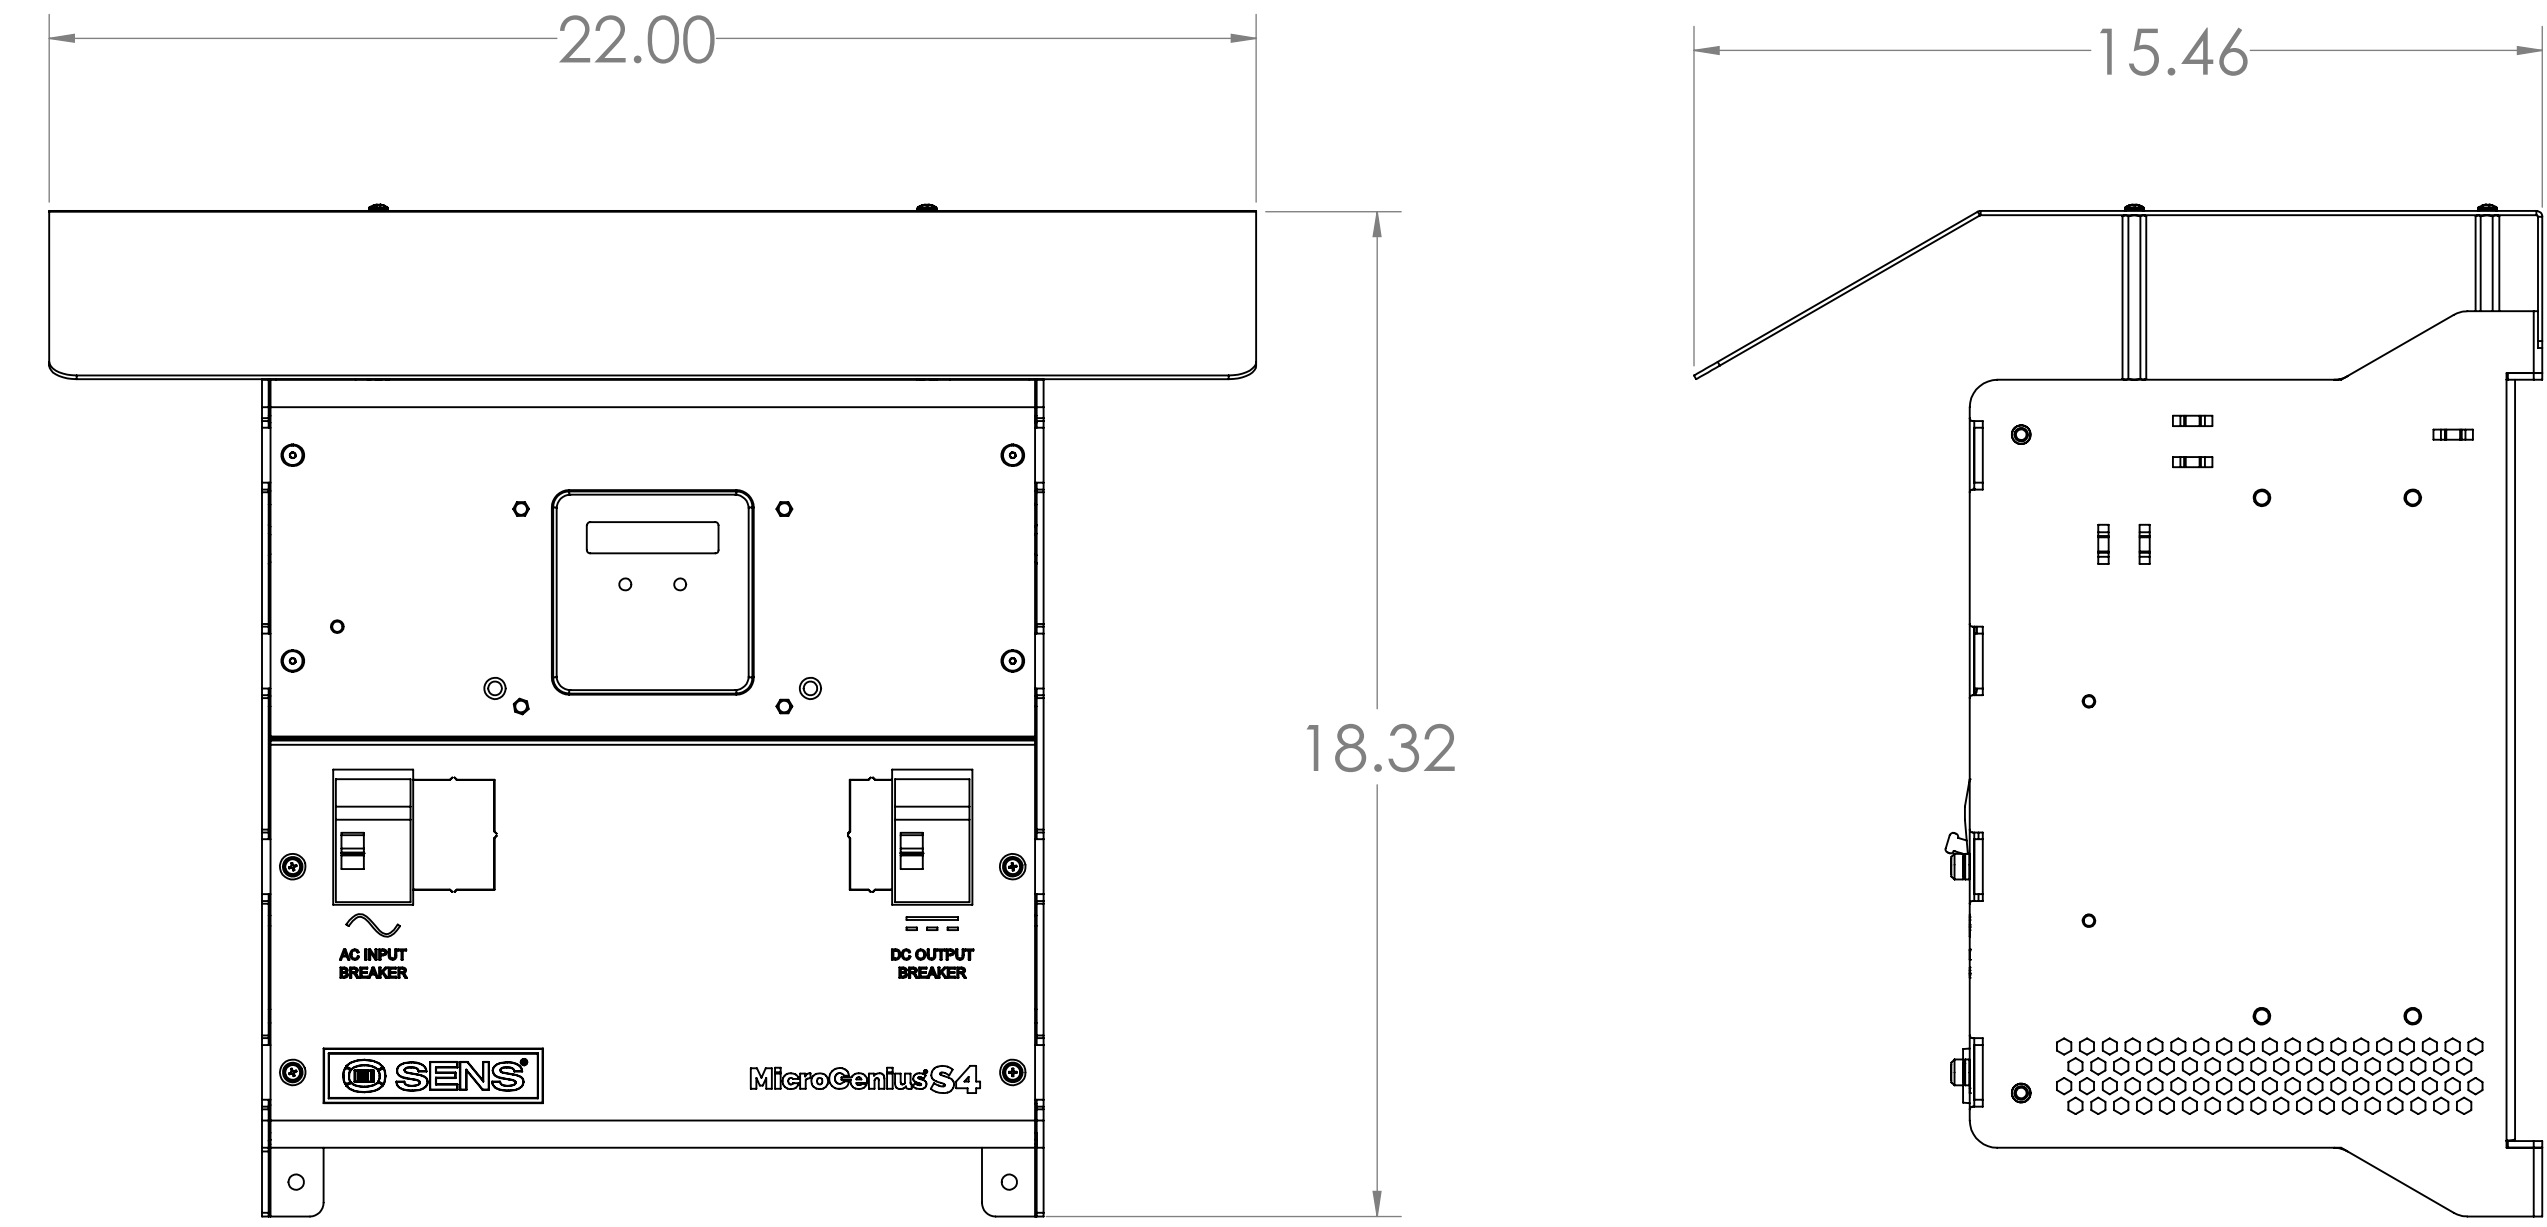


1 IN NPT CONDUIT OPENING FOR AC WIRING
 3/4 IN NPT CONDUIT OPENING FOR COMMUNICATION WIRING
 1-1/4 IN NPT CONDUIT OPENING FOR DC WIRING

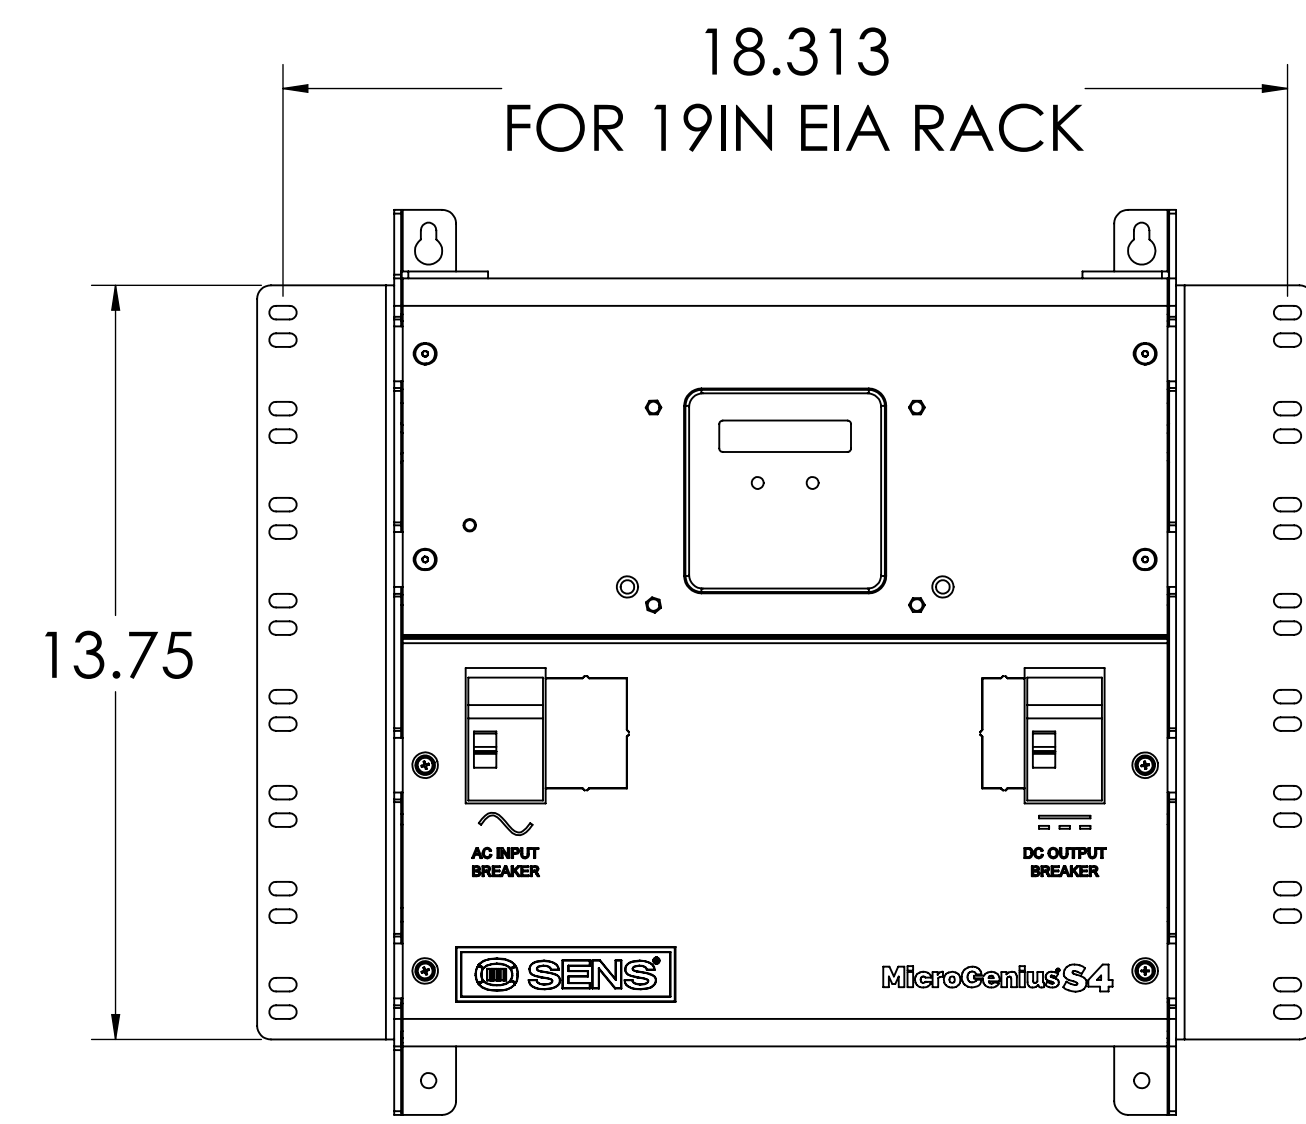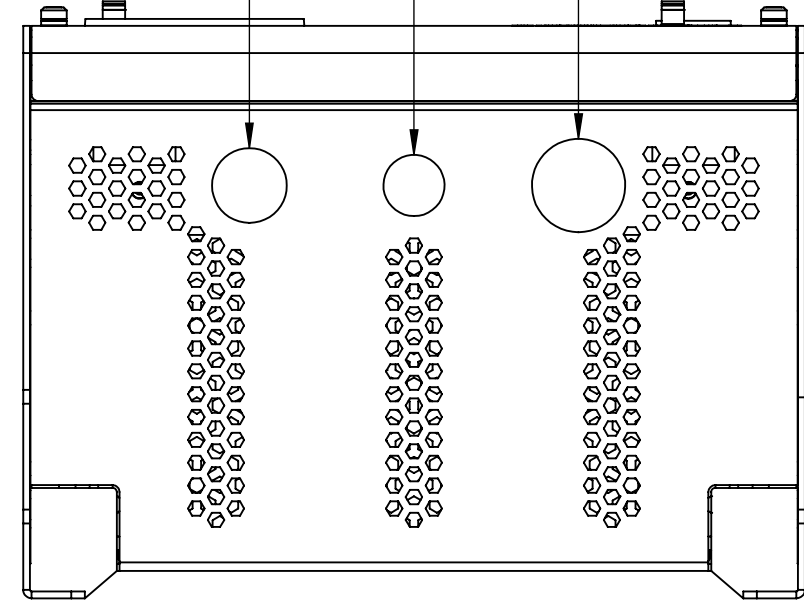

19IN RACKMOUNT BRACKETS

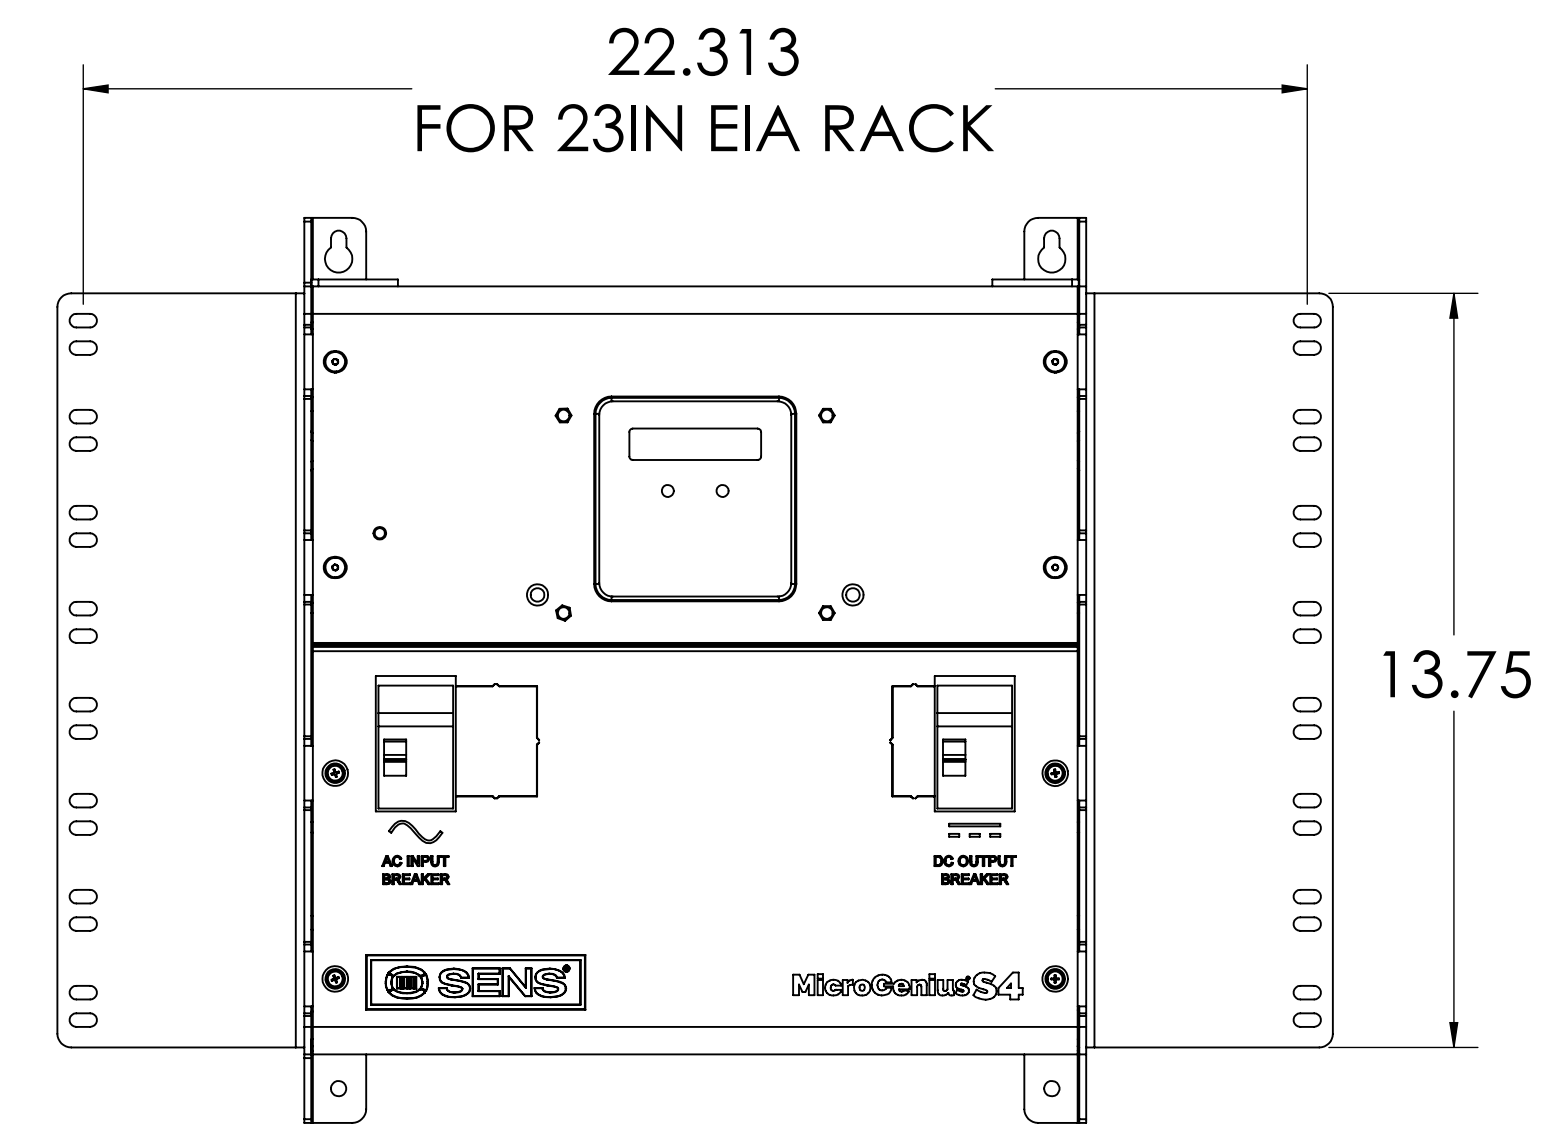

23IN RACKMOUNT BRACKETS

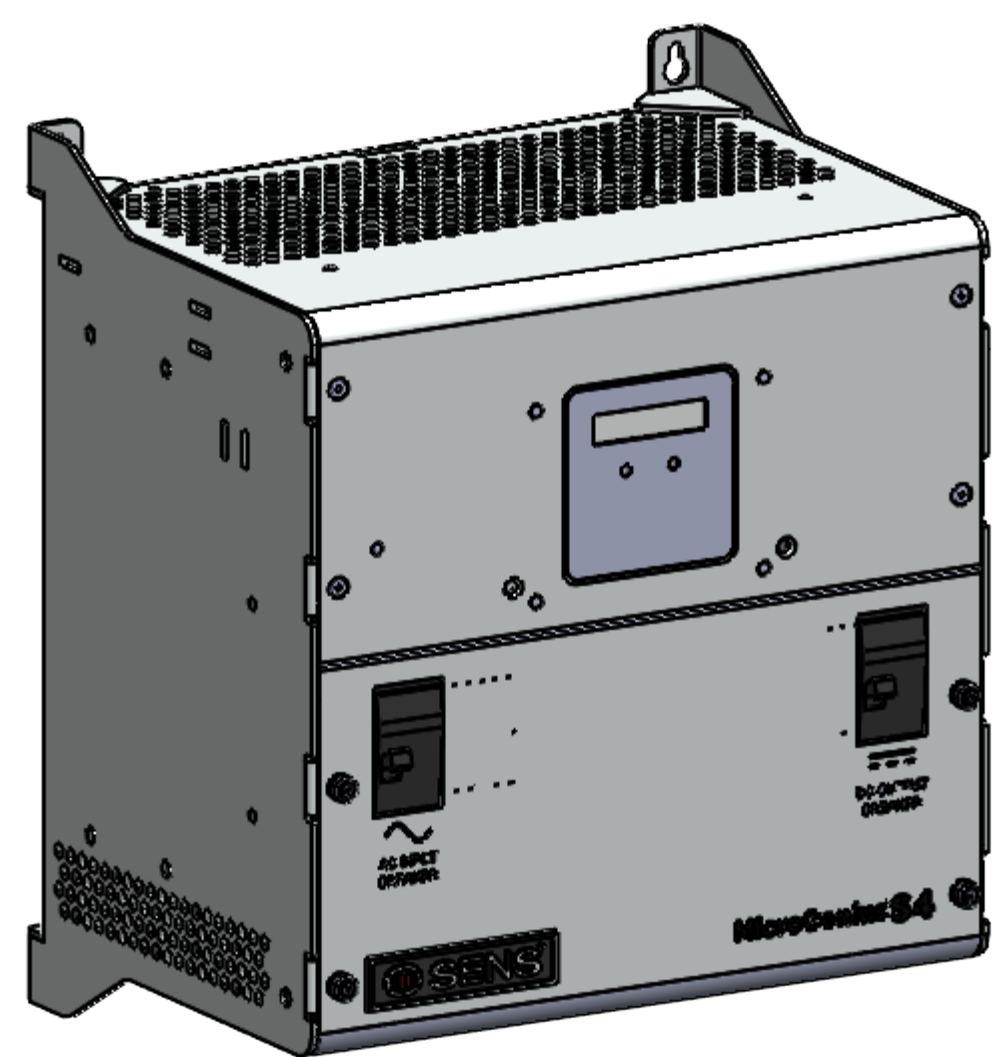

| | | | | | |
|--|--|-------------|---|----------------------------------|--------------|
| <p>SENS STORED ENERGY SYSTEMS</p> <p>1840 INDUSTRIAL CIRCLE LONGMONT, CO 80501 303-478-7500 WWW.SENS-USA.COM</p> <p>PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF STORED ENERGY SYSTEMS, LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF STORED ENERGY SYSTEMS, LLC IS PROHIBITED.</p> | UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES DEFAULT TOLERANCES: ± 1/16" | NAME ERS | DATE 9/8/2017 | DESCRIPTION 2DCAD,S4,STANDARD | |
| | DO NOT SCALE DRAWING | CHECKED | THIRD ANGLE PROJECTION | SIZE D | |
| | | | DIMENSIONS & TOLERANCES PER ASME Y14.5 - 2009 | DOCUMENT NUMBER 2DCAD-S4-STD | REV B |
| | | | | | SHEET 1 OF 1 |